

ELEKTROTECHNICKÝ ZKUŠEBNÍ ÚSTAV



ELECTROTECHNICAL TESTING INSTITUTE - CZECH REPUBLIC
ELEKTROTECHNISCHE PRÜFANSTALT - TSCHHECHISCHE REPUBLIK
INSTITUT ELECTROTECHNIQUE D'ESSAIS - RÉPUBLIQUE TCHÈQUE
ЭЛЕКТРОТЕХНИЧЕСКИЙ ИСПЫТАТЕЛЬНЫЙ ИНСТИТУТ - ЧЕШСКАЯ РЕСПУБЛИКА

Pod lisem 129/2, 171 02 Praha 8 - Troja

CERTIFICATE

No.: 1180262

Product: Empty Insulating Enclosures

Type: 3D (see Annex)

Rating: IP54, IP44, IK10, outdoor installation from SMC material, Ui 1000 V

Ordering firm: ELPLAST - KPZ Rokycany, spol. s r.o.
Mlečice 45, 338 08 Zbiroh, Czech Republic

Manufacturer: ELPLAST - KPZ Rokycany, spol. s r.o.
Mlečice 45, 338 08 Zbiroh, Czech Republic

Trade mark:

The test results are stated in the test-report No.: 704708-02/01 of: 28.03.2018

A sample of the product was found to be in conformity with:
ČSN EN 62208 ed.2:12

Other data:

Certificate was issued on the basis of fulfillment of requirements of the "EZÚ certificate" certification scheme and on the basis of agreement No. 704708 between the client and the Electrotechnical Testing Institute.

Compliance of the product with mentioned standards and regulations ensures compliance of the product with essential requirements of Government Order No. 118/2016 Sb. (2014/35/EU) as amended and the certificate may be used as a supporting document for the EU Declaration of Conformity under Act No. 90/2016 Coll., on Conformity Assessment of Products When Made Available on the Market, as amended.

The validity of the certificate is limited to: 30.04.2021

18.04.2018

Prague

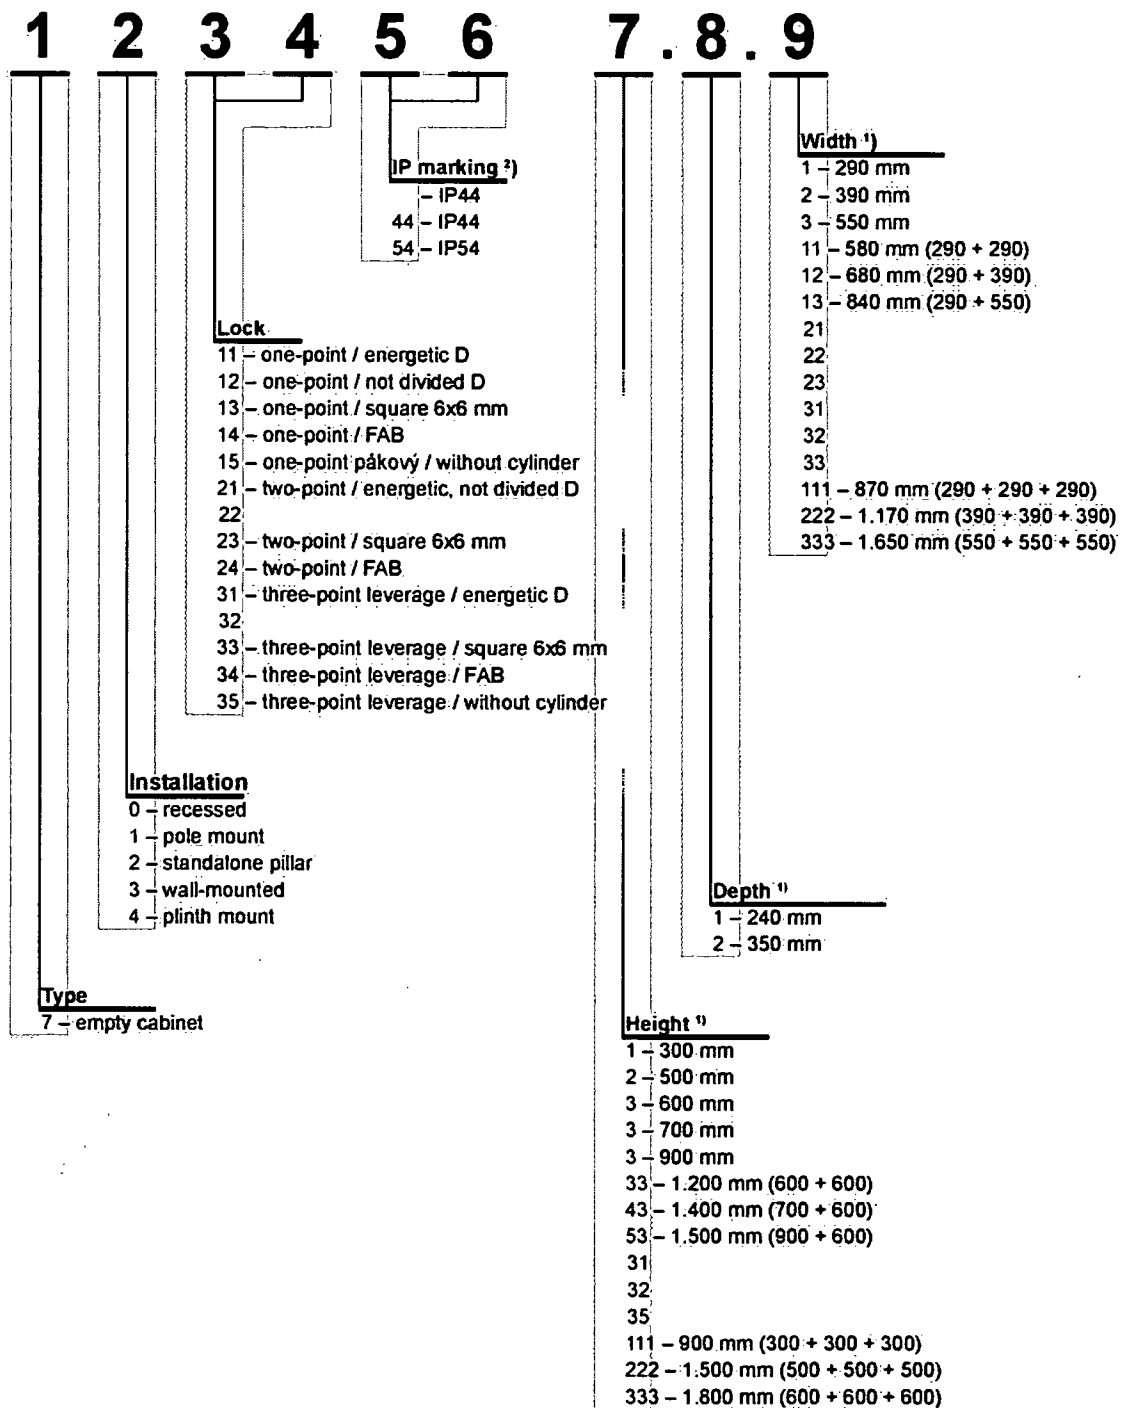

Mgr. Miroslav Sedláček
Head of Certification Body



704708-02

Marking system – 3D cabinets

The basic system of catalog numbers usage



1) Individual cabinets can be mounted side by side and superimposed in an endless series. Number of variants is incomplete.

2) Cabinets meet requirements of IP44 covering (not stated). Only increased covering IP54 is stated (it is necessary to fix IP54 cabinets with three-point leverage lock system).

